

- Globe valves, 3-way, with external thread
- for open and closed cold and warm water systems
 - for modulating water-side control of air handling units and heating systems



Type overview

Type	k_{vs} [m ³ /h]	DN [mm]	Stroke [mm]	S_v
H511B	0.63	15	15	>50
H512B	1	15	15	>50
H513B	1.6	15	15	>50
H514B	2.5	15	15	>50
H515B	4	15	15	>50
H520B	6.3	20	15	>100
H525B	10	25	15	>100
H532B	16	32	15	>100
H540B	25	40	15	>100
H550B	40	50	15	>100

Technical data

Functional data	Flow media	Cold and warm water, water with max. 50% volume of glycol
	Temperature of medium	(-10 °C) +5 °C ... +120 °C (-10 °C on request)
	Rated pressure p_s	1600 kPa (PN16)
	Flow characteristic	Control path A – AB: equal percentage (to VDI/VDE 2173) $n(g) = 3$, optimized in the opening range bypass B – AB: linear (to VDI/VDE 2173)
	Rangeability S_v	See «Type overview»
	Leakage rate	Control path A – AB: leakage class III (DIN EN 1349 and DIN EN 60534-4) bypass B – AB: max. 1% of k_{vs} value
	Pipe connection	External thread to ISO 228
	Stroke	See «Type overview»
	Valve closing point	Up (▲)
	Installation position	Upright to horizontal (in relation to the stem)
	Maintenance	Maintenance-free
	Materials	Fitting
Valve cone		Stainless steel
Valve stem		Stainless steel
Valve seat		Red casting brass Rg5 / Niro (bypass)
Stem gland seal		EPDM O-Ring
Dimensions / Weights	Dimensions and weights	See «Dimensions and weights», page 3
Motorizing	See the Complete overview «The complete range of water solutions»	

Safety notes




- This globe valve has been designed for use in stationary heating, ventilation and air conditioning systems and is not allowed to be used outside the specified field of application, especially in aircraft or in any other airborne means of transport.
- It may only be installed by suitably trained personnel.
- All applicable legal or institutional installation regulations must be complied with.
- The valve does not contain any parts that can be replaced or repaired by the user.
- The valve is not allowed to be disposed of as household refuse. All locally valid regulations and requirements must be observed.
- The recognized rules should be applied when determining the flow characteristic of final controlling elements.

Product features


- Mode of operation** The globe valve is operated by an NV series linear actuator. The linear actuators are controlled by a standard modulating or 3-point control system and move the cone of the valve, the throttling device, to the opening position dictated by the control signal.
- Flow characteristic** An equal-percentage flow characteristic is produced by profiling the valve cone. The bypass exhibits a linear characteristic curve.
- Manual operation** On the NV linear actuator, the valve stem can be actuated manually using a hexagonal key.

Installation notes

- Recommended mounting positions** The globe valve may be mounted either **vertically** or **horizontally**. It is not permissible, mounting the globe valve with the stem pointing downwards.

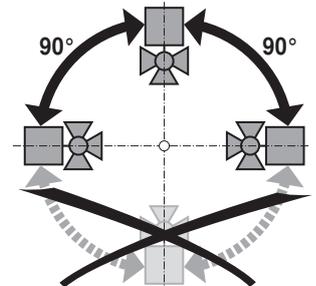

- Water quality requirements**
- The water quality requirements specified in VDI 2035 must be adhered to.
 - Globe valves are relatively sensitive control devices. In order to ensure a long service life, it is advisable to fit **strainers**.
- Maintenance**
- The globe valves and linear actuators are maintenance-free.
 - Before any kind of service work is carried out on actuator sets of this type, it is essential to isolate the linear actuator from the power supply (by unplugging the power lead). Any pumps in the part of the piping system concerned must also be switched off and the appropriate isolating fittings closed (allow everything to cool down first if necessary and reduce the pressure in the system to atmospheric).
 - The system must not be returned to service until the globe valve and the linear actuator have been properly reassembled in accordance with the instructions and the pipework has been refilled in the proper manner.
- Direction of flow** The direction of flow, specified by an arrow on the housing, is to be complied with, since otherwise the globe valve can be damaged.

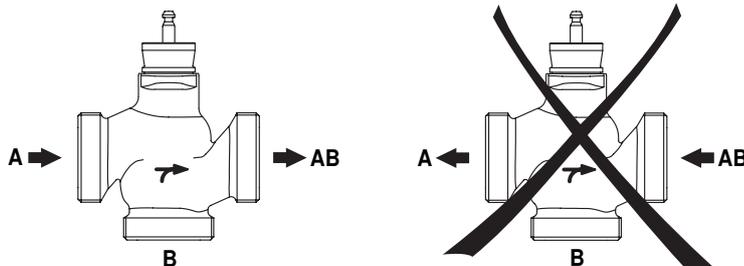


Accessories

	Description
Mechanical accessories	Stem heating ZH24-1 (45 W)
	Pipe connector ZH45..
	Blanked connection for sealing the bypass ZH5..

Dimensions and weights

Dimensional drawings

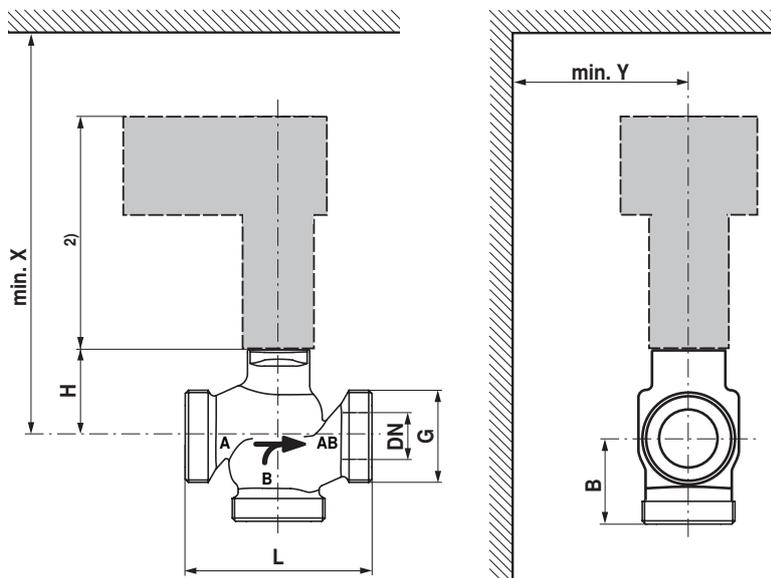

DN [mm]	G ["]	L [mm]	H [mm]	B [mm]	X 1) [mm]	Y 1) [mm]	Weight [kg]
15	1 1/8	80	46	55	350	100	1.1
20	1 1/4	90	46	55	350	100	1.2
25	1 1/2	110	52	55	350	100	1.4
32	2	120	56	55	350	100	2.0
40	2 1/4	130	65	60	350	100	2.5
50	2 3/4	150	65	65	350	100	3.6

1) Minimum distance with respect to the valve centre.

2) The actuator dimensions can be found on the respective actuator data sheet.

Further documentations

- Complete overview «The complete range of water solutions»
- Data sheets actuators
- Installation instructions for globe valves and/or actuators
- Notes for project planning (hydraulic characteristic curves and circuits, installation regulations, commissioning, maintenance etc.)