



2-Port Seat Valves with Flange, PN 16

VVF45...

- Nodular cast iron EN-GJS-400-15 valve body
- DN 50...150
- k_{vs} 19...300 m³/h
- Can be equipped with SKB...- or SKC...- electrohydraulic actuators

Use

For use in district heating, heating, ventilating, and air conditioning systems as a control or safety shutoff valve

For open and closed circuits (mind cavitation, refer to page 5).

Type summary

Type reference	DN	k_{vs} [m ³ / h]	S_v
VVF45.49	50	19	> 50
VVF45.50		31	
VVF45.65	65	49	
VVF45.80	80	78	
VVF45.90	100	124	
VVF45.91	125	200	
VVF45.92	150	300	

DN = Nominal size

k_{vs} = Nominal flow rate of cold water (5...30 °C) through the fully open valve (H_{100}) by a differential pressure of 100 kPa (1 bar)

S_v = Rangeability k_{vs} / k_{vr}

k_{vr} = Smallest k_v value, at which the flow characteristic tolerances can still be maintained, by a differential pressure of 100 kPa (1 bar)

High performance versions

Type	Type suffix	Description	Examples
VVF45...4	4	Sealing gland with PTFE sleeve for temperatures up to 180 °C	VVF45.654

Accessories

Type	Description
ASZ6.5	Electric stem heating element, AC 24 V / 30 W, required for media below 0 °C

Order

When ordering please give quantity, product name and type reference.

Example: 2 2-port valves VVF45.50

Delivery

Valves, actuators and accessories are packed and supplied separately.

The valves are supplied without counter-flanges and without flange gaskets.

Spare parts

See overview, section "Spare parts", page 10

Equipment combinations

Valves	H_{100} [mm]	Actuators			
		SKB...		SKC...	
		Δp_{max}	Δp_s	Δp_{max}	Δp_s
[kPa]					
VVF45.49	20	1200	1600		
VVF45.50					
VVF45.65	40			1000	1600
VVF45.80				700	
VVF45.90				450	
VVF45.91				300	
VVF45.92				200	

H_{100} = Nominal stroke

Δp_{max} = Maximum permissible differential pressure across the valve, valid for the entire actuating range of the motorized valve

Δp_s = Maximum permissible differential pressure at which the motorised valve will close securely against the pressure (close off pressure).

Actuator overview

Type	Actuator type	Operating voltage	Positioning signal	Spring return	Positioning time	Positioning force	Data sheet	
SKB32.50	Electro-hydraulic	AC 230 V	3-position	No	120 s	2800 N	N4564	
SKB32.51				Yes				
SKB82.50		AC 24 V	DC 0...10 V ¹⁾	No				N4566
SKB82.51				Yes				
SKB60		No						
SKB62...		Yes						
SKC32.60	Electro-hydraulic	AC 230 V	3-position	No	120 s	2800 N	N4564	
SKC32.61				Yes				
SKC82.60		AC 24 V	DC 0...10 V ¹⁾	No				N4566
SKC82.61				Yes				
SKC60		No						
SKC62...		Yes						


¹⁾ or DC 4...20 mA

Pneumatic actuators

Do not use VVF45... with pneumatic actuators.

Technical design / mechanical design

Valve cross section

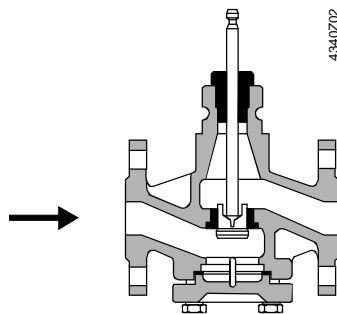


For all nominal sizes, a guided slot plug is used that is directly connected to the valve stem.

The seat is screwed to the valve body with the aid of special gland material.




The two-port seat valve does not become a three-port valve by removing the blank flange!

Flow diagram

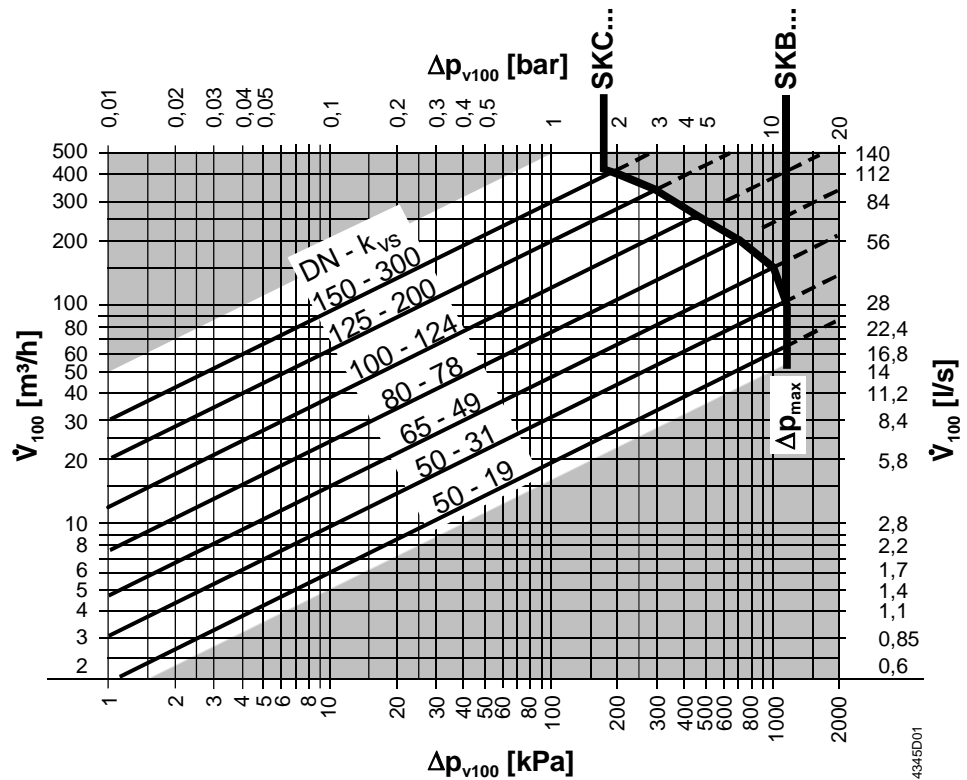

- Δp_{max} = Maximum permissible differential pressure across the valve, valid for the entire actuating range of the motorised valve
- Δp_{v100} = Differential pressure across the fully open valve and the valve's control path by a volume flow \dot{V}_{100}
- \dot{V}_{100} = Volume flow through the fully open valve (H_{100})
- 100 kPa = 1 bar \approx 10 mWC
- 1 m^3/h = 0.278 l/s water at 20 °C

Valve flow characteristic

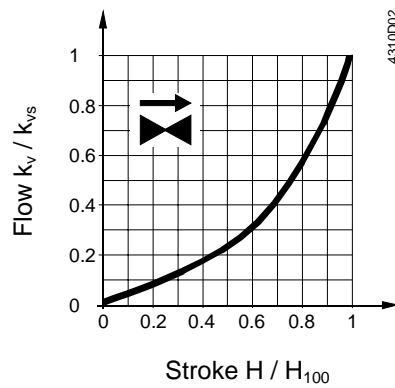


- 0...30 % → linear
- 30...100 % → equal percentage
- $n_{gl} = 3$ as per VDI / VDE 2173

Cavitation


Cavitation accelerates wear on the valve plug and seat, and also results in undesirable noise. Cavitation can be avoided by not exceeding the differential pressure shown in the flow diagram on page 4, and by adhering to the static pressures shown below.

Note on chilled water

To avoid cavitation in chilled water circuits ensure sufficient counter pressure at valve outlet, e.g. by a throttling valve after the heat exchanger. Select the pressure drop across the valve at maximum according to the 80 °C curve in the flow diagram below.

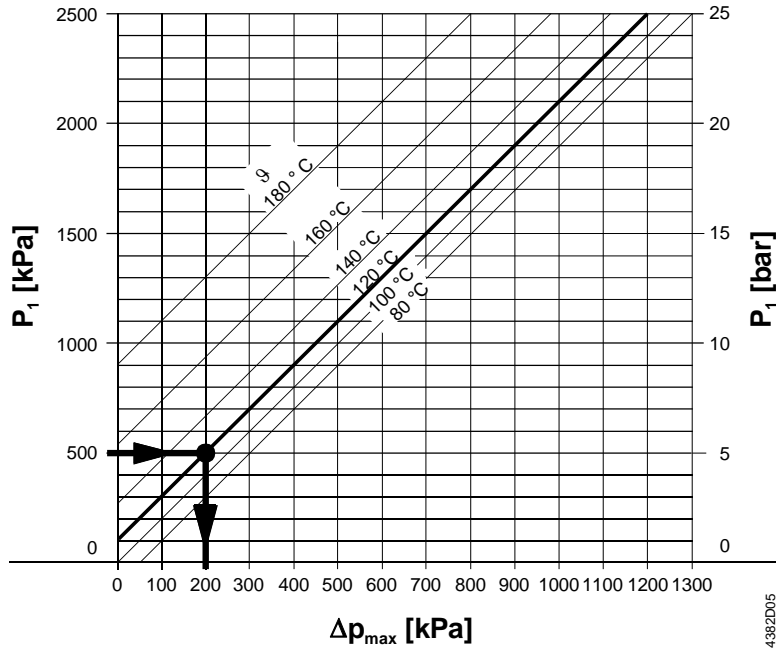

- Δp_{max} = Differential pressure with valve almost closed, at which cavitation can largely be avoided
- p_1 = Static pressure at inlet
- p_3 = Static pressure at outlet
- M = Pump
- ϑ = Water temperature

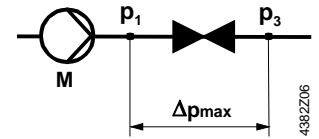

High temperature hot water example:


Pressure p_1 at valve inlet: 500 kPa (5 bar)
 Water temperature: 120 °C

From the diagram above, it will be seen that with the valve almost closed, the maximum permissible differential pressure Δp_{max} is 200 kPa (2 bar).

Chilled water example:


Spring water cooling as an example of avoiding cavitation:

- Chilled water = 12 °C
- p_1 = 500 kPa (5 bar)
- p_4 = 100 kPa (1 bar) (atmospheric pressure)
- Δp_{max} = 300 kPa (3 bar)
- $\Delta p_{3-3'}$ = 20 kPa (0.2 bar)
- Δp_D (throttle) = 80 kPa (0.8 bar)
- $p_{3'}$ = pressure after consumer in kPa

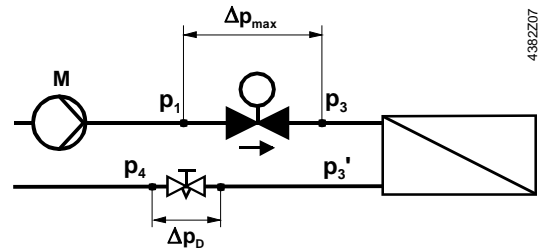

Working pressure and medium temperature


Fluids

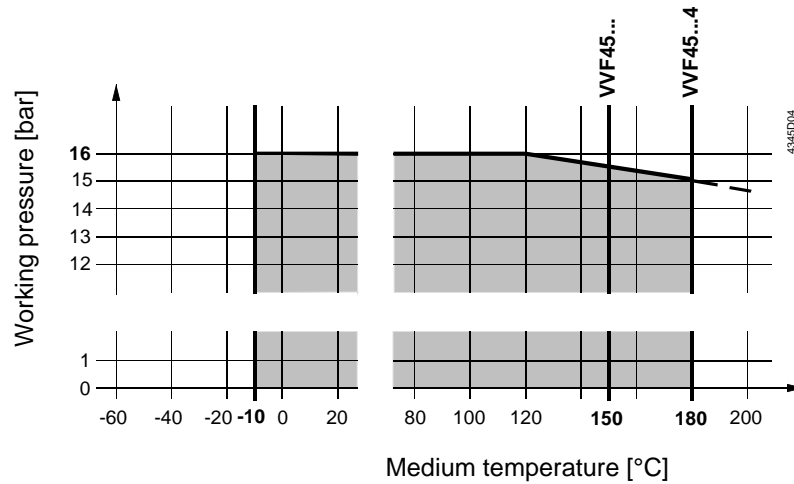

Working pressure and medium temperature staged as per ISO 7005

Current local legislation must be observed.

Saturated steam
Superheated steam

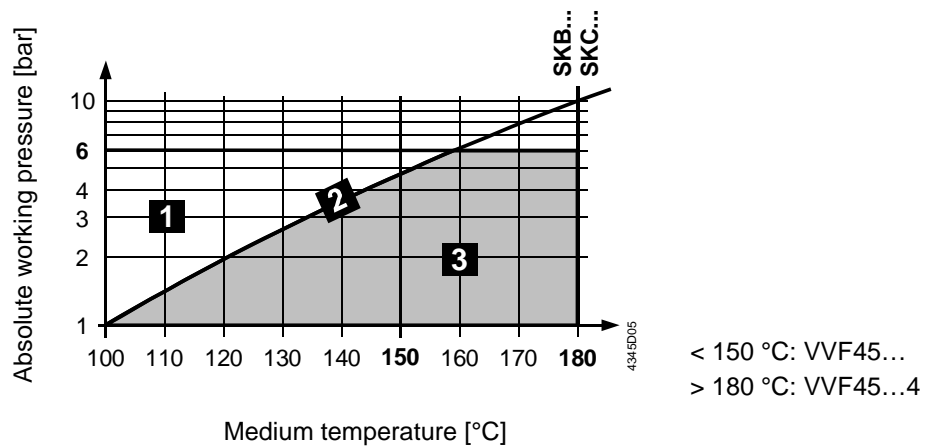

1	wet steam	avoid
2	saturated steam	permissible range of use
3	superheated steam	

Recommendation

For saturated steam and superheated steam the differential pressure Δp_{\max} across the valve should be close to the critical pressure ratio.

$$\text{Pressure ratio} = \frac{p_1 - p_3}{p_1} \cdot 100\%$$

p_1 = absolute pressure before valve in kPa
 p_3 = absolute pressure after valve in kPa

Calculation of the k_{vs} value for steam

Subcritical range

$$\frac{p_1 - p_3}{p_1} \cdot 100\% < 42\%$$

Pressure ratio < 42% subcritical

$$k_{vs} = 4.4 \cdot \frac{\dot{m}}{\sqrt{p_3 \cdot (p_1 - p_3)}} \cdot k$$

Supercritical range

$$\frac{p_1 - p_3}{p_1} \cdot 100\% \geq 42\%$$

Pressure ratio \geq 42% supercritical
(not recommended)

$$k_{vs} = 8.8 \cdot \frac{\dot{m}}{p_1} \cdot k$$

\dot{m} = steam quantity in kg/h

k = factor for superheating of steam = $1 + 0.0012 \cdot \Delta T$ ($k = 1$ for saturated steam)

ΔT = temperature differential in K between saturated steam and superheated steam

Example

given	saturated steam 143.6 °C $p_1 = 400 \text{ kPa (4 bar)}$ $\dot{m} = 1400 \text{ kg/h}$ pressure ratio = 30 %	saturated steam 143.6 °C $p_1 = 400 \text{ kPa (4 bar)}$ $\dot{m} = 1400 \text{ kg/h}$ pressure ratio = 42 % (supercritical permitted)
required	k_{vs} , valve type	k_{vs} , valve type
procedure	$p_3 = p_1 - \frac{30 \cdot p_1}{100}$ $p_3 = 400 - \frac{30 \cdot 400}{100} = 280 \text{ kPa (2.8bar)}$ $k_{vs} = 4.4 \cdot \frac{1400}{\sqrt{280 \cdot (400 - 280)}} \cdot 1 = 33.6 \text{ m}^3 / \text{h}$	$k_{vs} = 8.8 \cdot \frac{1400}{400} \cdot 1 = 30.8 \text{ m}^3 / \text{h}$
selected	$k_{vs} = 49 \text{ m}^3/\text{h} \Rightarrow \text{VVF45.654}$	$k_{vs} = 31 \text{ m}^3/\text{h} \Rightarrow \text{VVF45.504}$

Notes

Engineering

We recommend installation in the return pipe, as the temperatures in this pipe are lower for applications in heating systems, which in turn, extends the stem sealing gland's life.



In open circuits the valve plug may seize as the result of scale deposits. In these applications, only the most powerful SKB... or SKC... actuators should be used. Further the valve should be exercised at regular intervals (two to three times per week). A strainer **MUST** be fitted at the valve inlet

Ensure cavitation free flow (refer to page 5).



To ensure the reliability of the valve, we recommend the fitting of a strainer at the valve inlet even in closed circuits.



For media below 0 °C, use the electric ASZ6.5 stem heating element to prevent the valve stem from freezing in the sealing gland. For safety reasons, the stem heating element has been designed for AC 24 V / 30 W operating voltage.


The use of these valves for steam is subject to specific parameters:
 Observe diagram for steam on page 6 and «Technical Data» on page 9!

Mounting

Both valve and actuator can easily be assembled at the mounting location. Neither special tools nor adjustments are required.

The valve is supplied with Mounting Instructions 74 319 0509 0.

Orientation



Direction of flow

When mounting, pay attention to the valve's flow direction symbol →.

Commissioning



Commission the valve only if the actuator has been mounted correctly.

Valve stem retracts: valve opens = increasing flow

Valve stem extends: valve closes = decreasing flow

Maintenance

Warning



VVF45... valves require no maintenance.

When doing service work on the valve / actuator:

- Deactivate the pump and turn off the power supply
- Close the shutoff valves
- Fully reduce the pressure in the piping system and allow pipes to completely cool down

If necessary, disconnect the electrical wires.

Before putting the valve into operation again, make certain the actuator is correctly fitted.

Stem sealing gland

The glands can be exchanged without removing the valve, provided the pipes are depressurized and cooled off and the stem surface is unharmed.

If the stem is damaged in the gland range, replace the entire stem-plug-unit.

Contact your local office or branch.

Disposal



Before disposal the valve must be dismantled and separated into its various constituent materials.

Legislation may demand special handling of certain components, or it may be sensible from an ecological point of view.

Current local legislation must be observed.

Warranty

The technical data given for these applications is valid only in conjunction with the Siemens actuators as detailed under «Equipment combinations».

All terms of the warranty will be invalidated by the use of actuators from other manufacturers.

Technical data


Functional data	PN class	PN 16 to ISO 7268
	Working pressure	to ISO 7005 within the permissible medium temperature range according to the diagram on page 6
	Flow characteristic	<ul style="list-style-type: none"> • 0...30 % • 30...100 %
	Leakage rate	0...0.02 % of k_{vs} value to DIN EN 1349
	Permissible media: water	cooling water, chilled water, low temperature hot water, high temperature hot water, water with anti-freeze; recommendation: water treatment to VDI 2035
	brine	
	steam	saturated steam, super-heated steam dryness at inlet minimum 0.98
	heat transfer oils	(use only valves with suffix 4)
	Medium temperature ¹⁾	max. 150 °C (180 °C)
	water, brine ²⁾	-10...150 °C (180 °C)
	saturated steam	≤ 180 °C ≤ 600kPa (6 bar) abs
	superheated steam	≤ 180 °C ≤ 600kPa (6 bar) abs
	heat transfer oils	permissible temperature and pressure range according to the diagram on page 6 ≤ 180 °C (use only valves with suffix 4)
	Rangeability S_v	DN 50...150: >100 (VVF45.49: > 50)
Nominal stroke	DN 50: 20 mm DN 65...150: 40 mm	
Industry standards	Pressure Equipment Directive	PED 97/23/EC
	Pressure Accessories	as per article 1, section 2.1.4
	Fluid group 2:	<ul style="list-style-type: none"> • DN 50 • DN 65...125 • DN 150
		<ul style="list-style-type: none"> • without CE-marking as per article 3, section 3 (sound engineering practice) • category I, with CE-marking • category II, with CE-marking, test authority number 0036
Materials	Valve body	nodular cast iron EN-GJS-400-15
	Stem	stainless steel
	Plug, seat	stainless steel
	Sealing gland	standard version: brass, silicon-free special version: stainless steel
	Gland materials	standard version: EPDM O-rings, silicon-free special version: VVF45...4: PTFE sleeves
Dimensions / Weight	Refer to «Dimensions»	
	Flange connections	to ISO 7005

¹⁾ For 150...180 °C use special versions with type suffix 4.

²⁾ Electric stem heating element ASZ6.5 required for media below 0 °C.

Dimensions

Dimensions in mm

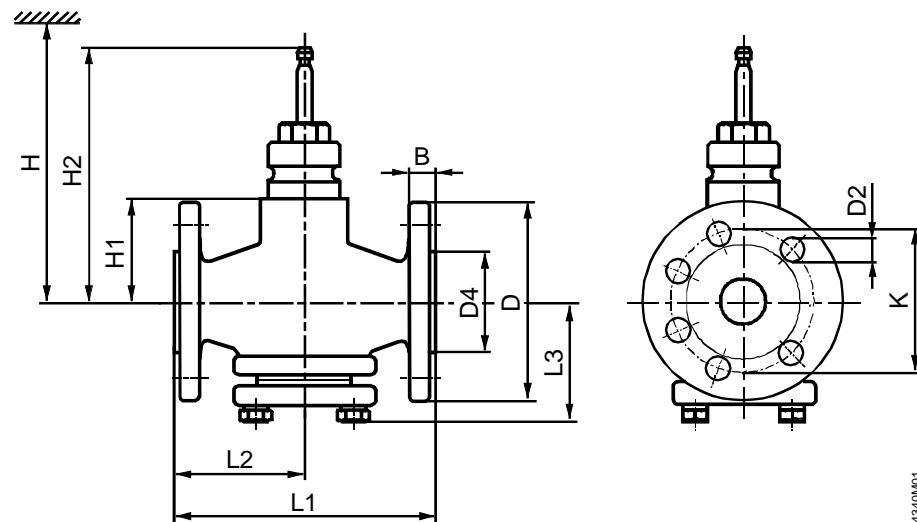

Type	DN	B	D Ø	D2 Ø	D4 Ø	K	L1	L2	L3	H1	H2	H		kg [kg]
												SKB...	SKC...	
VVF45.49	50	20	165	19 (4x)	99	125	230	115	96	96	192.5	> 671		15
VVF45.50			185		118	145	290	145	126	114	230.5	> 689	23.5	
VVF45.65	65													
VVF45.80	80	22	200	19 (8x)	132	160	310	155	148	126	242.5		> 701	30
VVF45.90	100	24	220		156	180	350	175	165	146	262.5		> 721	39
VVF45.91	125	26	250		184	210	400	200	184	163	279.5		> 738	59.5
VVF45.92	150		285	23 (8x)	211	240	480	240	210	186	302.5		> 761	82

DN = Nominal size

H = Total actuator height plus minimum distance to the wall or the ceiling for mounting, connection, operation, maintenance etc.

H1 = Dimension from the pipe centre to install the actuator (upper edge)

H2 = Valve in the «Closed» position means that the valve stem is fully extended

Spare parts

Order numbers for spare parts

Valve	Sealing gland		Set
	VVF45...	VVF45...4	Plug with stem, circlip, sealing
VVF45.49	4 679 5629 0	4 679 5630 0	74 676 0058 0
VVF45.50	4 679 5629 0	4 679 5630 0	74 676 0059 0
VVF45.65	4 679 5629 0	4 679 5630 0	74 676 0048 0
VVF45.80	4 679 5629 0	4 679 5630 0	74 676 0049 0
VVF45.90	4 679 5629 0	4 679 5630 0	74 676 0050 0
VVF45.91	4 679 5629 0	4 679 5630 0	74 676 0051 0
VVF45.92	4 679 5629 0	4 679 5630 0	74 676 0052 0