

SQL35.00
SQL85.00

SQL36E...



Electromotoric Actuators

for VKF41..., VKF46...TS butterfly valves

SQL35.00
SQL85.00
SQL36E...

- SQL35.00, SQL36E... operating voltage AC 230 V, 3-position control signal
- SQL85.00 operating voltage AC 24 V, 3-position control signal
- Nominal angle of rotation 90°
- Auxiliary switch and potentiometer for extra functions
- Manual adjuster and position indicator
- SQL36E... built-in heating element to avoid condensation
- SQL36E... compatible with EN ISO 5211 flanges
- SQL36E... variable positioning time with SEZ31.1 auxiliary module

Use

For operation of VKF41..., VKF46... and VKF46...TS butterfly valves as control and shutoff valves in heating, ventilation and air conditioning plants.

Type summary

| Type | Operating voltage | Positioning signal | Positioning time for 90° at 50 Hz | | Positioning force | Flange connection EN 5211 | |
|--------------------|-------------------|--------------------|-----------------------------------|--------------|-------------------|---------------------------|--|
| | | | without SEZ31.1 | with SEZ31.1 | | | |
| SQL35.00 | AC 230 V | 3-position | 125 s | | 20 Nm | | |
| SQL85.00 | AC 24 V | | 25 s | | 40 Nm | F04 | |
| SQL36E50F04 | AC 230 V | | 6 s | 30...180 s | 100 Nm | F05 | |
| SQL36E50F05 | | | 12 s | 60...360 s | 400 Nm | F07 | |
| SQL36E65 | | | 24 s | 120...720 s | 1200 Nm | F10 | |
| SQL36E110 | | | | | | 1) | |
| SQL36E160 | | | | | | | |

1) EN 5211 F12 / F16 flange connections for third-party actuators are available on request.

Accessories

| Type | Description | For actuators | Mounting position |
|----------------|--|----------------------|---|
| ASC9.5 | Auxiliary switch | SQL35.00 SQL85.00 | 1 x ASC9.5 or 1 x ASC9.4 or 1 x ASZ7.4 (only one accessory at a time can be mounted) |
| ASC9.4 | Double auxiliary switch | | |
| ASZ7.4 | Auxiliary switch and potentiometer 1000 Ω | | |
| SEZ31.1 | Auxiliary module for variable positioning time (refer to «Function/mechanical design», page 4) | | |
| ASC36 | Double auxiliary switch | | |
| ASZ36 | Potentiometer 1000 Ω | | |

Order

The actuator, butterfly valve, mounting kit and any accessories must be ordered separately.

When ordering please specify the quantity, product name and type code.

Example: **1 actuator, type SQL35.00, 1 mounting kit, type ASK35.1 and 1 auxiliary switch with potentiometer, type ASZ7.4**

Delivery

The actuator, butterfly valve, mounting kit and accessories are packed separately and delivered as individual items.

Equipment combinations

| Butterfly valves | Electromotoric actuators | | | | | | Mounting kit | Data sheet |
|-------------------------------|--------------------------|-------------------|-------------------|----------|-----------|-----------|-----------------|------------|
| | SQL35.00 SQL85.00 | SQL36E50F04 1) | SQL36E50F05 1) | SQL36E65 | SQL36E110 | SQL36E160 | | |
| VKF46.40 | ✓ | ✓ | | | | | ASK35.1 | N4136 |
| VKF46.50 | ✓ | ✓ | | | | | | |
| VKF46.65 | ✓ | ✓ | | | | | | |
| VKF46.80 | ✓ | | ✓ | | | | | |
| VKF46.100 | ✓ | | | ✓ | | | | |
| VKF46.125 | ✓ | | | ✓ | | | | |
| VKF46.150 | | | | ✓ | | | | |
| VKF46.200 | | | | ✓ | | | | |
| VKF46.250 | | | | | ✓ | | | |
| VKF46.300 | | | | | ✓ | | | |
| VKF46.350 | | | | | ✓ | | Direct mounting | N4136 |
| VKF46.400 | | | | | ✓ | | | |
| VKF46.450 | | | | | ✓ | | | |
| VKF46.500 | | | | | ✓ | | | |
| VKF46.600 | | | | | ✓ | | | |
| VKF46.350TS | | | | | | ✓ | Direct mounting | N4136 |
| VKF46.400TS | | | | | | ✓ | | |
| VKF46.450TS | | | | | | ✓ | | |
| VKF46.500TS | | | | | | ✓ | | |
| VKF46.600TS | | | | | | ✓ | | |
| VKF41.150...200 | ✓ | | | | | | ASK35 | N4131 |
| VKF45.40...125 ²⁾ | ✓ | | | | | | ASK35 | N4135 |
| VKF45.150...200 ²⁾ | ✓ + ASK35 | | | | ✓ | | Direct mounting | |

¹⁾ SQL36E50... actuators can be mounted directly on VKF46... butterfly valves.

²⁾ VKF45... butterfly valves were replaced by VKF46... butterfly valves in 2000. For actuator retrofitting on installed butterfly valves, replacement of actuators or ASK35:


- VKF45.40...125: Use SQL35.00 / SQL85.00 actuators and ASK35
- VKF45.150...200: Mounting of SQL36E65 actuator recommended

Function / mechanical design

The actuator is driven by a 3-position signal from the controller and generates a rotary motion which is transferred via a driver to the valve.

SQL35.00 SQL85.00

These electromotoric actuators require no maintenance. They have a reversible synchronous motor and reduction gears with self-lubricating sinter bearings.

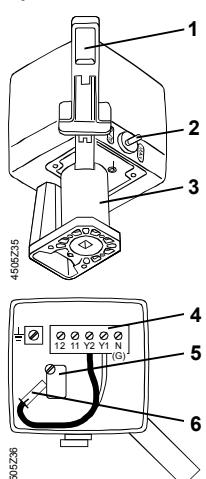

- 1 Manual lever
- 2 Rotary «AUTO» / «MAN» selector
- 3 Yoke

When the selector is set to «MAN», the butterfly valve can be operated with a manual lever. For manual operation, the angle of rotation is mechanically limited by an end stop.



- 4 Terminal strip
- 5 Double end switch (always factory-installed)
- 6 Plug for reversing direction of rotation

SQL36E...

These electromotoric actuators require no maintenance. They have a reversible asynchronous motor which drives the main shaft via spur gears and a self-locking worm gear, which accommodates the rectangular shaft of the butterfly valve. The worm shaft is fitted with a direct-acting manual adjuster.

The actuators are supplied with a 90° angle of rotation suitable for use with Siemens butterfly valves. During automatic operation, rotation is limited by two built-in end-switches.


The direction of rotation of the actuator can be reversed (refer to «Commissioning»). To prevent the temperature inside the housing from falling below the dewpoint temperature, the actuators are supplied with a built-in heating element (AC 230 V, power consumption 5 W).

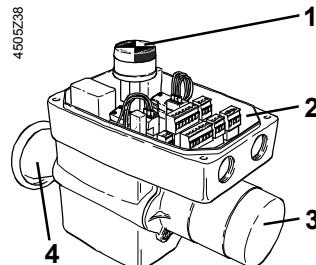

- 1 Position indication
- 2 Terminal compartment
- 3 Motor
- 4 Manual adjuster

Accessory for
SQL36E65
SQL36E110
SQL36E160

SEZ31.1



Auxiliary module

In the presence of a 3-position signal, the auxiliary module pulses the actuator. The output shaft rotates by approximately 2° with each pulse. The pulse-to-pause ratio is continuously adjustable and can therefore be used to achieve longer running times for an angle of rotation of 90° (refer to «Commissioning»).

Engineering notes

Electrical installation

The actuators must be electrically connected in accordance with local regulations and with the connection diagrams.



Regulations and requirements to ensure the safety of people and property must be observed at all times.

Mounting notes

Overview of
Mounting Instructions

| Type | Mounting Instructions |
|-------------------|-----------------------|
| SQL35.00/SQL85.00 | M4290.4 74 319 0215 0 |
| ASK35... | M4290.4 74 319 0215 0 |
| ASK35 | M4135.1 4 319 5556 0 |
| ASC9.4 | G4506.5 4 319 5537 0 |
| ASC9.5 | G4506.7 4 319 5557 0 |
| ASZ7.4 | G4506.6 4 319 5538 0 |

| Type | Mounting Instructions |
|-----------|-----------------------|
| SQL36E... | M4505.1 74 319 0440 0 |
| ASC36 | M4505.3 74 319 0442 0 |
| ASZ36 | M4505.2 74 319 0441 0 |
| SEZ31.1 | M4505.4 74 319 0443 0 |

SQL35.00 / SQL85.00

These actuators must be used with the following mounting kit:

- ASK35.1 or ASK35.2 for VKF46... butterfly valves
- ASK35 for VKF41.150 and VKF41.200 butterfly valves


SQL36E...

These actuators are mounted directly on type VKF46... butterfly valves. The butterfly valves have to be closed during installation.

In case of unsteady ambient temperatures connect the built-in heating element to avoid condensation.

The valve and actuator can be assembled straightforwardly on site. There is no need for special tools.

Orientation

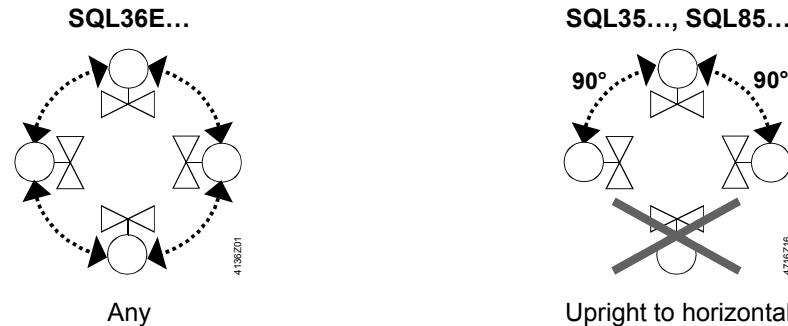

Commissioning notes

When commissioning the complete motorized valve consisting of actuator, mounting kit and butterfly valve, always check the wiring and test the functions. This also applies to any additional components fitted, e.g. auxiliary switch, potentiometer or auxiliary module (variable positioning time).

VKF41... or VKF46... butterfly valves can only be commissioned with a SQL35.00 / SQL85.00 or SQL36E... actuator or with an ASK46... manual adjuster fitted.

Warning

To avoid pressure shocks on the butterfly, the VKF46... must be driven to its fully open position (either manually or via positioning signal Y1) prior to activating the pump(s).

The flow rate is adjusted either by driving the electric actuators as required, or by operating the manual adjuster.

When using a SEZ31.1 auxiliary module set the desired positioning time:

SQL36E65: 30...180 s

SQL36E110: 60...360 s


SQL36E160: 120...720 s

Operating mode

SQL35.00 / SQL85.00



«AUTO» = automatic operation



«MAN» = manual operation


SQL36E...

In the case of the SQL36E..., the manual adjuster is always engaged and cannot be mechanically disconnected.

Direction of rotation

SQL35.00 / SQL85.00

The actuators are factory-set to rotate in clockwise direction for opening (as seen from the cover).

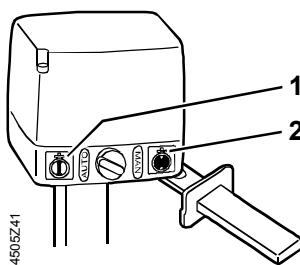

Position indication

The adhesive labels supplied must be applied during assembly.


1 Butterfly valve

in «OPEN» position

2 Butterfly valve

in «CLOSED» position


SQL36E...

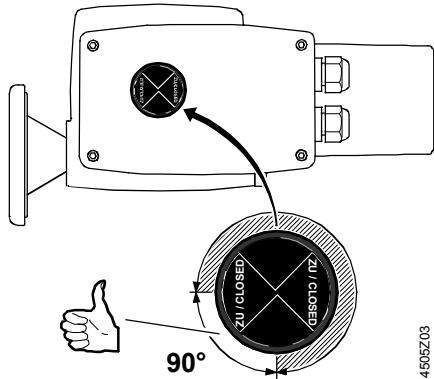

The direction of rotation of these types of actuators for opening is counterclockwise.

Reversing the direction of rotation SQL35.00 / SQL85.00

The direction of rotation can be reversed by repositioning a connector located under the cover. The wiring for the OPEN and CLOSE control signal is not affected

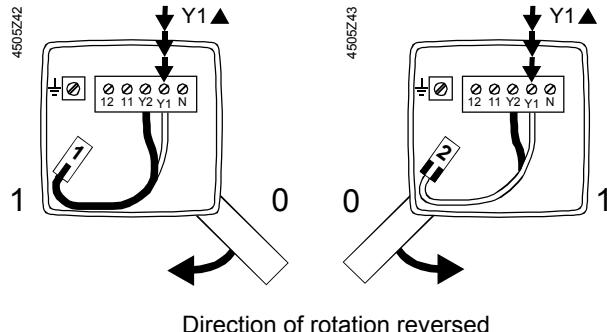

SQL36E...

If the direction of rotation needs reversing, simply change the connections Y1/Y2.

Setting the angle of rotation

The 0...90° angle of rotation for the end switches is factory-set and cannot be changed. The potential-free auxiliary switches have adjustable switching points.

Control

Every actuator must be driven by a dedicated controller (refer to «Connection diagrams»).

Maintenance

The actuators and butterfly valves require no maintenance.

Caution




Before performing any service work on the valve or actuator:

- Switch off the pump and power supply
 - Close the main shut-off valves in the pipework
 - Release pressure in the pipes and allow them to cool down completely
- If necessary, disconnect electrical connections from terminals.

The valve must be re-commissioned only with the manual adjuster or the actuator correctly assembled.

Disposal



The actuator contains electrical and electronic components and must not be disposed of together with domestic waste.

Legislation may demand special handling of certain components, or it may be sensible from an ecological point of view.

Current local legislation must be observed.

Warranty

The technical data given for these applications is valid only in conjunction with the Siemens butterfly valves as detailed under «Equipment combinations». The use of third-party valves other than those recommended by Siemens invalidates the warranty.

Technical data

| | | SQL35.00 | SQL85.00 | SQL36E50... | SQL36E65 | SQL36E110 | SQL36E160 |
|----------------|---|-------------------------|---|---|------------------------|---------------------|-----------|
| Power supply | Operating voltage | AC 230 V ±15 % | AC 24 V ±20 % | | AC 230 V -5 / +10 % | | |
| | Frequency | | | 50 / 60 Hz | | | |
| Control | Power consumption ¹⁾ | 6.5 VA | 35 VA | 160 VA | 235 VA | | |
| | Positioning signal | | | 3-position | | | |
| Operating data | Parallel operation | | | parallel operation of several actuators not possible | | | |
| | Positioning time for 90° | | | | | | |
| | at 50 Hz | 125 s | 25 s | 6 s ²⁾ | 12 s ²⁾ | 24 s ²⁾ | |
| | at 60 Hz | 105 s | 20 s | 5 s | 10 s | 20 s | |
| | Angle of rotation | | | 90° ± 1° (factory setting) | | | |
| | Torque ¹⁾ | 20 Nm | 40 Nm | 100 Nm | 400 Nm | 1200 Nm | |
| | End switch | | Switching capacity Switching differential | AC 250 V, 3 A resistive, 1.5 A inductive approx. 1° | | | |
| | Heating element | | | AC 230 V, 5 W | | | |
| | Medium temperature | | | Permissible temperature of medium in the assembled valve: 120°C | | | |
| | Meets the requirements for | | EMC directive 89/336/EEC | | | | |
| | CE marking in | | Low-voltage directive 73/23/EEC | | | | |
| | Electromagnetic compatibility | | AC emissions: EN 61000-3-ff, EN 55014-1 and EN 55022 AC + DC immunity: EN 61000-4-ff | | | | |
| | Product standards for automatic electrical controls | EN 60730-2-14 | | DIN EN 61010 | | | |
| | C-tick | | | N474 | | | |
| | Housing protection standard | IP 44 to IEC 60529 | | IP 67 to IEC 60529 | | | |
| | Protection class | III or II to EN 60730 | | | | | |
| | Flanges and shaft connection to actuator | | | EN ISO 5211 F04 / F05 F07 F10 | | □ 32mm F12 / F16 | |
| | Dimensions | | see «Dimensions» | | | | |
| | Cable glands | 4 x Ø 20,5 mm (for M20) | | 2 x M20 | | | |
| | Weight | 1.4 kg | 4.5 kg | 7 kg | 14 kg | 25 kg | |
| Materials | Housing base, yoke | | | die-cast aluminium | | | |
| | Cover | plastic | | die-cast aluminium | | | |

¹⁾ These values apply at nominal voltage, at an ambient temperature of 20 °C and at the specified nominal running time

²⁾ Variable positioning time with SEZ31.1 auxiliary module (see below)


| Accessories for SQL35.00 / 85.00 | | | Weight |
|--|--|---|----------------------------|
| • Double auxiliary switch ASC9.5 / ASC9.4 | Switching capacity Switching differential | AC 250 V, 10 A resistive, 3 A inductive approx. 1° | ASC9.4 85 g ASC9.5 30 g |
| • Auxiliary switch with potentiometer ASZ7.4 | Switching capacity Switching differential Change in resistance | AC 250 V, 10 A resistive, 3 A inductive approx. 1° 0 ... 1000 Ω corresponding to 0 ... 90 ° | 60 g |
| | | | |

| Accessories for SQL36E... | | | Weight |
|---------------------------------|--|---|--------|
| • Double auxiliary switch ASC36 | Switching capacity Switching differential | AC 250 V, 3 A resistive, 1.5 A inductive approx. 1° | 60 g |
| • Potentiometer ASZ36 | Change in resistance | 0...1000 Ω corresponding to 0...90° | 50 g |
| • Auxiliary module SEZ31.1 | Positioning time for 90 ° at 50 Hz | SQL36E65: 30...180 s SQL36E110: 60...360 s SQL36E160: 120...720 s | 60 g |

| General ambient conditions | Operation | | Transport | Storage |
|-------------------------------|--|----------------------------------|--|----------------|
| | EN 60721-3-3 SQL35.00 / SQL85.00 | EN 60721-3-4 SQL36E... | EN 60721-3-2 SQL35.00 / SQL85.00 / SQL36E... | EN 60721-3-1 |
| Environmental conditions | Class 3K5 | Class 4K2 | Class 2K3 | Class 1K3 |
| Temperature | -15...+55 °C | -20...+70 °C | -30...+65 °C | -15...+55 °C |
| Humidity | 5...95 % r. h. | 15...100 % r. h. | < 95 % r. h. | 0...95 % r. h. |


Internal diagrams

SQL35.00

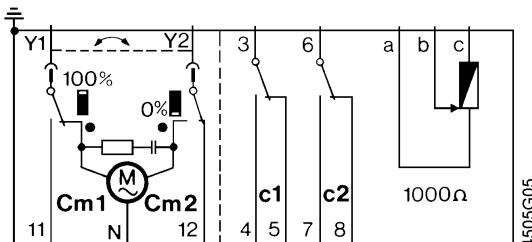


Cm1
 Cm2
 c1
 c1, c2
 1000Ω
 End switch
 End switch
 1 auxiliary switch **ASC9.5**
 or
 1 double auxiliary switch
ASC9.4
 or
 1 built-in unit **ASZ7.4**
 (1 auxiliary switch and
 1 potentiometer)

SQL85.00

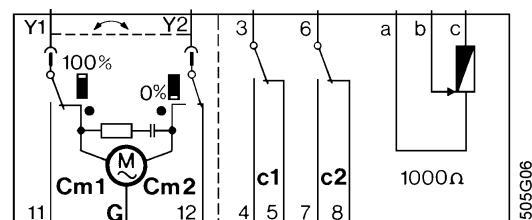


N
 G
 Y1
 Y2
 11
 12
 Neutral conductor
 System potential
 Control phase OPEN
 Control phase CLOSED
 Sequence Y1 at 90°
 Sequence Y2 at 0°

SQL36E50F04
SQL36E50F05

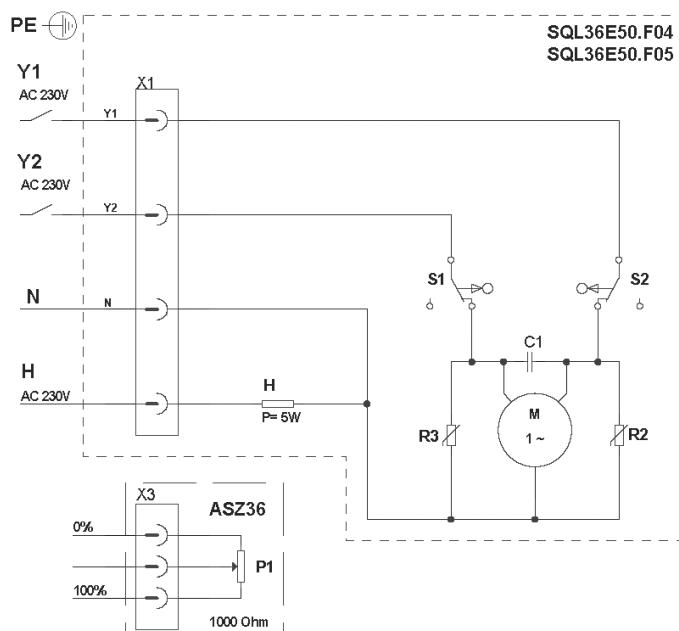


S1
 S2
 S3
 S4
 H
 P1
 Y1
 Y2
 N
 N.C.
 N.O.
 COM

End switch CLOSED
 End switch OPEN
 Auxiliary switch
 CLOSED (ASC36)
 Auxiliary switch
 OPEN (ASC36)
 Heating element
 Potentiometer
 (ASZ36)
 Control phase OPEN
 Control phase
 CLOSED
 Neutral conductor
 Normally Closed
 Normally Open
 Common conductor

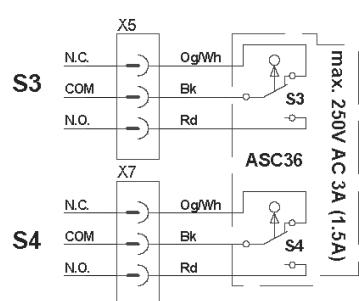

4505G07


SQL36E65
SQL36E110
SQL36E160

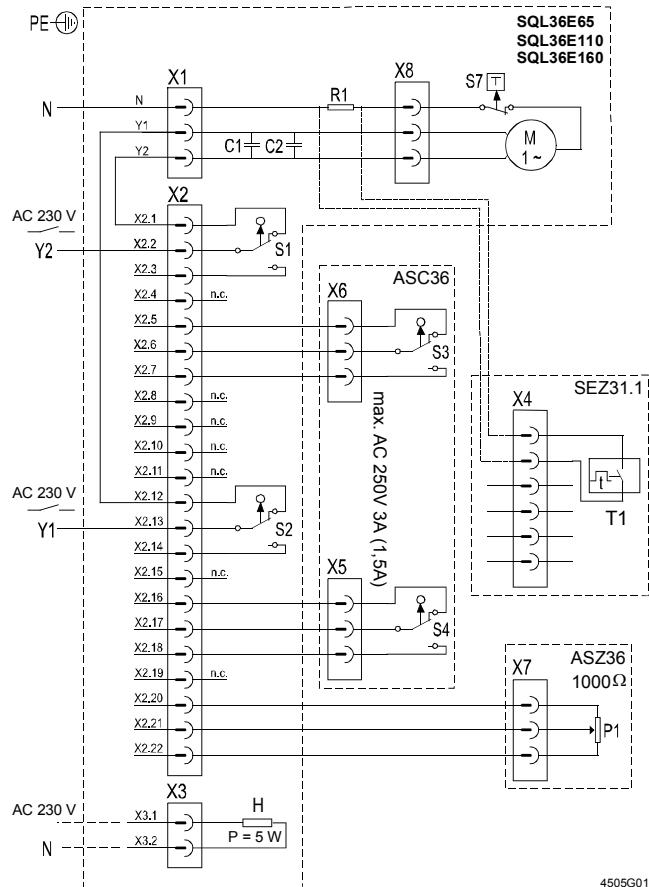

- S1 End switch CLOSED
- S2 End switch OPEN
- S3 Auxiliary switch CLOSED (ASC36)
- S4 Auxiliary switch OPEN (ASC36)
- S7 Thermal switch (integrated)
- H Heating element
- P1 Potentiometer (ASZ36)
- T1 Auxiliary module (SEZ31.1)
- Y1 Control phase OPEN
- Y2 Control phase CLOSED
- N Neutral conductor


Connection diagrams

SQL35.00
SQL36E...

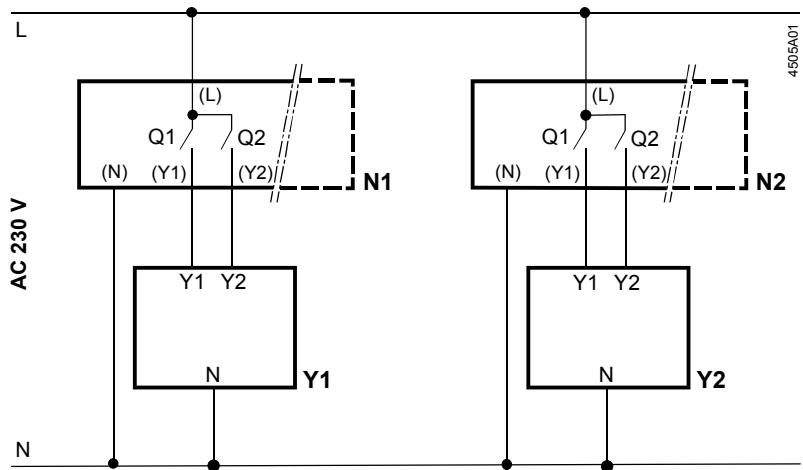

- N1, N2** Controller
- Y1, Y2** Actuator
- L** System potential AC 230 V
- N** System neutral
- Q1, Q2** Controller contacts

SQL85.00

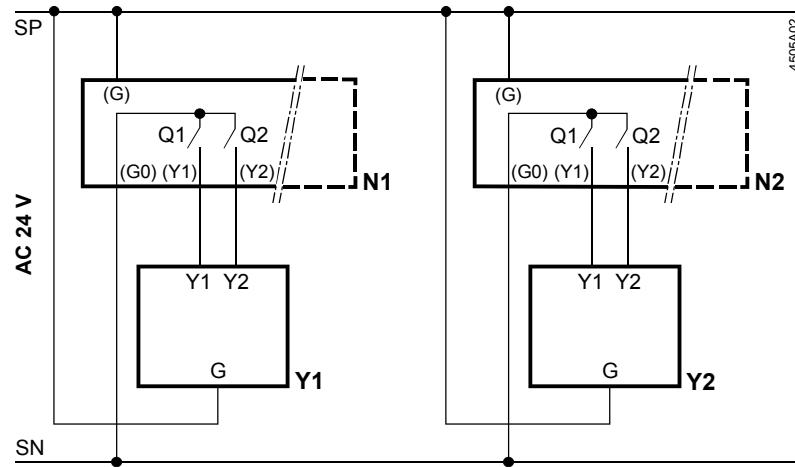

N1, N2 Controller

Y1, Y2 Actuator


SP System potential AC 24 V

SN System neutral

Q1, Q2 Controller contacts

Dimensions

SQL35.00
SQL85.00

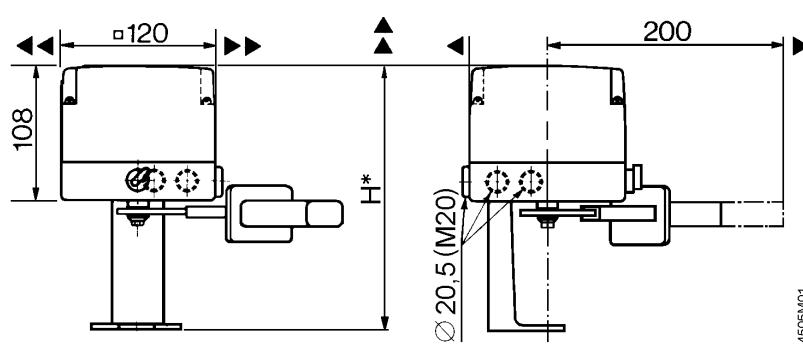


* Mounting height of actuator including ASK35... mounting kit = 168 mm

◀ > 100 mm: Minimum clearance from wall or ceiling

▲ > 200 mm: For mounting, connection, operation, service, etc.

SQL36E50F04
SQL36E50F05

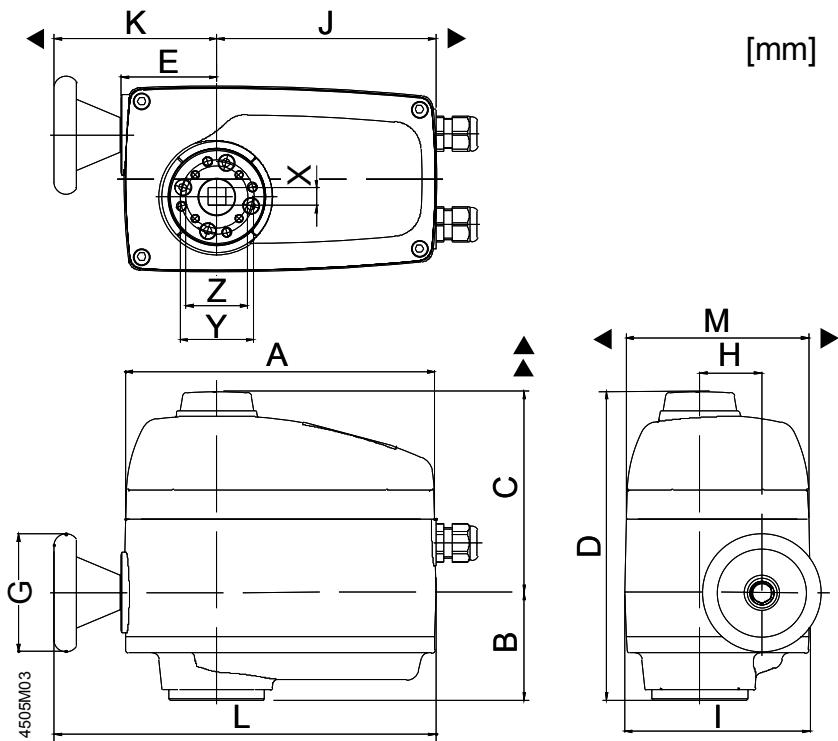


| | SQL36E50F04 | SQL36E50F05 |
|----------------|-------------|-------------|
| DN | 40...65 | 80...125 |
| A | 210 | |
| B | 73 | |
| C | 137 | |
| D | 210 | |
| E | 65 | |
| G | Ø 80 | |
| H | 42 | |
| I | 126 | |
| J | 149 | |
| K | 110 | |
| L | 259 | |
| M | 124 | |
| X | □ 11 | □ 14 |
| Y | 42 | |
| Z | | 50 |
| EN 5211 | F04 | F05 |
| kg | 4.5 kg | |

◀ > 100 mm: Minimum clearance from wall or ceiling

▲ > 200 mm: For mounting, connection, operation, service, etc.

SQL36E65
SQL36E110
SQL36E160

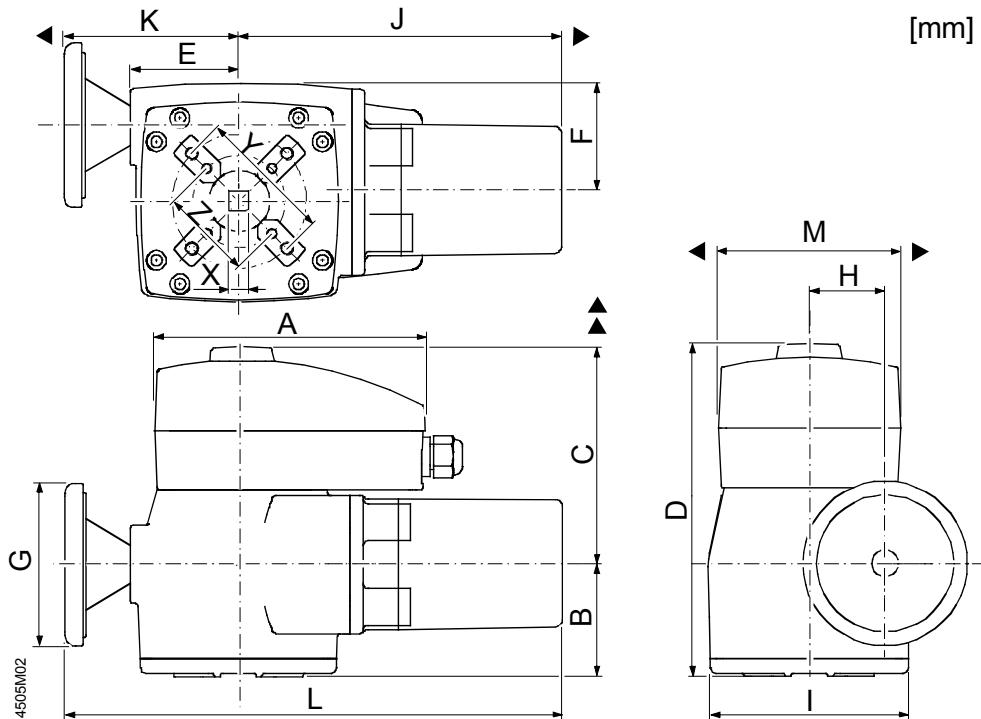

| | SQL36E65 | SQL36E110 | SQL36E160 |
|----------------|-----------------|------------------|-------------------------------|
| DN | 150...200 | 250...400 | (350) 450...600 ¹⁾ |
| A | 208 | 208 | 208 |
| B | 78 | 88 | 112 |
| C | 157 | 169 | 170 |
| D | 235 | 257 | 282 |
| E | 65 | 81 | 110 |
| F | 65 | 87 | 126 |
| G | Ø 80 | Ø 125 | Ø 200 |
| H | 42 | 58 | 89 |
| I | 125 | 150 | 175 |
| J | 171 | 247 | 280 |
| K | 119 | 136 | 157 |
| L | 290 | 383 | 437 |
| M | 139 | 139 | 139 |
| X | □ 17 | □ 22 | □ 32 |
| Y | 70 | 102 | 165 |
| Z | 50 | 70 | 125 |
| EN 5211 | F07 | F10 | ²⁾ |
| [kg] | 7 kg | 14 kg | 25 kg |

¹⁾ DN 350 / 400: VKF46.350TS, VKF46.400TS

²⁾ EN 5211 F12 / F16 flange connections for third-party actuators are available on request.

◀ > 100 mm: Minimum clearance from wall or ceiling

▲ > 200 mm: For mounting, connection, operation, service, etc.